

序号	报告编号	发布日期	结论	影像资料
26	GX-B1301/25-1-25008	2025.12.16	综合判定:合格。	 2025.12.16
27	GX-B1312/20-1-25517	2025.12.16	所检项目合格。	 2025.12.20

28	GX-B1598/24-1-25104	2025.12.17	实测钢丝绳有效截面积损失百分比最大为 2.35%，小于5%为正常。 。		 2025.12.6	
29	GX-B1598/24-1-25105	2025.12.17	实测钢丝绳有效截面积损失百分比最大为 2.02%，小于5%为正常。 。		 2025.12.6	

30	GX-B1598/24-1-25106	2025.12.17	实测钢丝绳有效截面积损失百分比最大为 2.65%，小于5%为正常。 。		 2025.12.6	
31	GX-B1598/24-1-25107	2025.12.17	实测钢丝绳有效截面积损失百分比最大为 2.03%，小于5%为正常。 。		 2025.12.6	

32	GX-B1598/24-1-25108	2025.12.17	实测钢丝绳有效截面积损失百分比最大为 2.17%，小于5%为正常。 。		 2025.12.6	
33	GX-B1598/24-1-25109	2025.12.17	实测钢丝绳有效截面积损失百分比最大为 3.13%，小于5%为正常。 。		 2025.12.6	

34	GX-B1598/24-1-25100	2025.12.17	实测钢丝绳有效截面积损失百分比最大为0.91%，小于5%为正常。		
35	GX-B1598/24-1-25101	2025.12.17	实测钢丝绳有效截面积损失百分比最大为0.67%，小于5%为正常。		

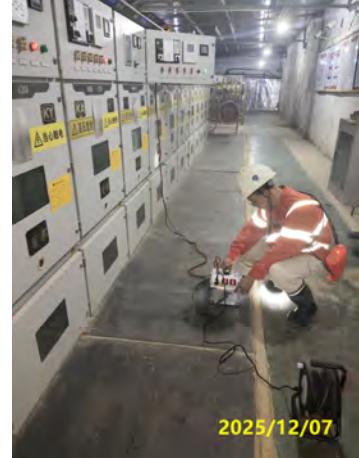
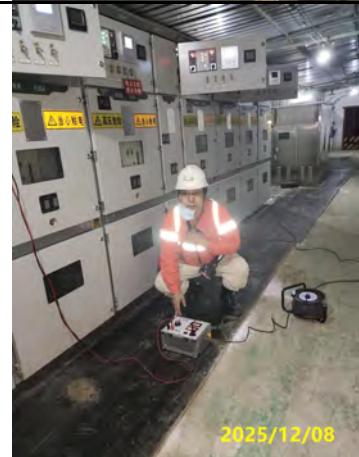
36	GX-B1598/24-1-25102	2025.12.17	实测钢丝绳有效截面积损失百分比最大为2.03%，小于5%为正常。		 2025.11.28	
37	GX-B1598/24-1-25103	2025.12.17	实测钢丝绳有效截面积损失百分比最大为1.72%，小于5%为正常。		 2025.11.29	

38	GX-B1321/20-1-251109~251114	2025.12.18	本次共检电力电缆6条，6条电力电缆所检项目合格。			
39	GX-B1321/20-1-251116~251124	2025.12.18	本次共检电力电缆9条，9条电力电缆所检项目合格。			

40	GX-B1313/21-1-25221	2025.12.18	所检项目合格。		 2025/12/16	
41	GX-B1322/21-1-25325~25326	2025.12.22	本次共检电力电缆2条，2条电力电缆所检项目合格。		 2025/12/16	

42	GX-B1451/20-1-25794~25795	2025.12.22	本次共检高压防爆开关2台，2台高压防爆开关所检项目合格。	 2025/12/16	
43	GX-B1451/20-1-25576~25585	2025.12.22	本次共检高压开关柜10台，10台高压开关柜所检项目合格。	 ①②③④⑤⑥⑦⑧⑨⑩	

44	GX-B1451/20-1-25586~25599	2025.12.22	本次共检高压开关柜14台,14台高压开关柜所检项目合格。		 2025.12.10	
45	GX-B1451/20-1-25600~25616	2025.12.22	本次共检高压开关柜17台,17台高压开关柜所检项目合格。		 2025.12.07	

46	GX-B1451/20-1-25617~25635	2025.12.22	本次共检高压开关柜19台,19台高压开关柜所检项目合格。		
47	GX-B1451/20-1-25636~25653	2025.12.22	本次共检高压开关柜18台,18台高压开关柜所检项目合格。		

48	GX-B1451/20-1-25654~25658	2025.12.22	本次共检高压开关柜5台,5台高压开关柜所检项目合格。		
49	GX-B1451/20-1-25659~25674	2025.12.22	本次共检高压开关柜16台,16台高压开关柜所检项目合格。		

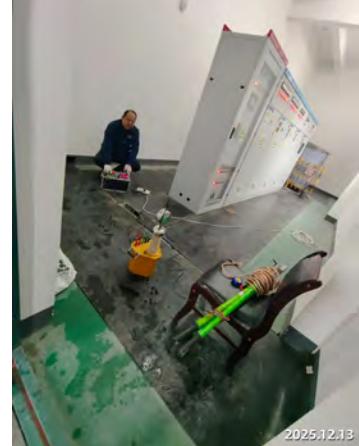
50	GX-B1451/20-1-25675~25684	2025.12.22	本次共检高压开关柜10台, 10台高压开关柜所检项目合格。		 2025/12/10	
51	GX-B1451/20-1-25685~25692	2025.12.22	本次共检高压开关柜8台, 8台高压开关柜所检项目合格。		 2025/12/10	

52	GX-B1451/20-1-25693~25702	2025.12.22	本次共检高压开关柜10台, 10台高压开关柜所检项目合格。	
53	GX-B1451/20-1-25796~25803	2025.12.22	本次共检高压开关柜8台, 8台高压开关柜所检项目合格。	

54	GX-B1451/20-1-25804~25809	2025.12.22	本次共检高压开关柜6台,6台高压开关柜所检项目合格。		
55	GX-B1451/20-1-25810~25823	2025.12.22	本次共检高压开关柜14台,14台高压开关柜所检项目合格。		

56	GX-B1451/20-1-25824~25829	2025.12.22	本次共检高压开关柜6台,6台高压开关柜所检项目合格。	 2025/12/12	
57	GX-B1328/25-1-25134	2025.12.22	本次共检绝缘杆4套,4套合格。	 2025/12/18	

58	GX-B1328/25-1-25135	2025.12.22	本次共检绝缘手套24只，24只绝缘手套合格。	 2025.12.13
59	GX-B1328/25-1-25136	2025.12.22	本次共检绝缘靴24只，24只绝缘靴合格。	 2025.12.13

60	GX-B1328/25-1-25137	2025.12.22	本次共检验电器8支， 8支验电器合格。		 2025.12.13	
61	GX-B1328/25-1-25138	2025.12.22	本次共检携带式接地 和接地短路装置8套， 8套携带式接地和接地 短路装置合格。		 2025.12.13	

62	GX-B1328/25-1-25139	2025.12.22	本次共检绝缘胶垫30个，30个绝缘胶垫合格。		 2025.12.13	
63	GX-B1404/20-1-25024	2025.12.22	所检电网谐波电压总谐波畸变率、各次谐波电压含有率、谐波电流符合GB/T 14549-1993《电能质量 公用电网谐波》要求。		 2025/12/4	

64	GX-B1404/20-1-25025	2025.12.22	所检电网谐波电压总谐波畸变率、各次谐波电压含有率、谐波电流符合GB/T 14549-1994《电能质量 公用电网谐波》要求。		
65	GX-B1404/20-1-25026	2025.12.22	所检电网谐波电压总谐波畸变率、各次谐波电压含有率、谐波电流符合GB/T 14549-1995《电能质量 公用电网谐波》要求。		

66	GX-B1310/21-1-25349	2025.12.22	符合标准要求		
67	GX-B1310/21-1-25354	2025.12.22	符合标准要求		

68	GX-B1428/21-1-25355	2025.12.22	无缺陷迹痕显示		 2025/11/28	
69	GX-B1310/21-1-25356	2025.12.22	符合标准要求		 2025/11/28	

70	GX-B1428/21-1-25357	2025.12.22	无缺陷迹痕显示			
71	GX-B1310/21-1-25350	2025.12.22	符合标准要求			

72	GX-B1310/21-1-25351	2025.12.22	符合标准要求		 2025/11/28	
73	GX-B1310/21-1-25352	2025.12.22	符合标准要求		 2025/11/29	

74	GX-B1310/21-1-25353	2025.12.22	符合标准要求			
75	GX-B1302/25-1-25002	2025.12.22	综合判定：合格。			

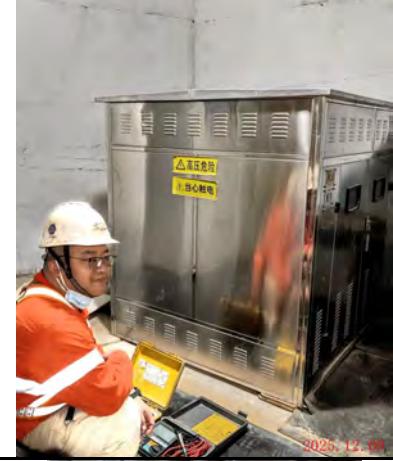
76	GX-B1302/25-1-25003	2025.12.22	综合判定：合格。		 2025/12/5	
77	GX-B1329/21-1-25144~25157	2025.12.22	本次共检氧化锌避雷器14组，14组所检项目合格。		 2025/12/12	

78	GX-B1307/20-1-25001	2025.12.22	综合判定：合格。	
79	GX-B1307/20-1-25002	2025.12.22	综合判定：合格。	

80	GX-B1350/21-1-25043	2025.12.23	本次共检接地装置8处，8处接地装置所检项目合格。		 2025/12/11	
81	GX-B1309/21-1-25034	2025.12.23	所检项目合格。		 2025/12/11	

82	GX-B1500/21-1-25127	2025.12.23	综合判定：合格。			
83	GX-B1500/21-1-25128	2025.12.23	综合判定：合格。			

84	GX-B1500/21-1-25129	2025.12.23	综合判定：合格。		 2025/12/11	
85	GX-B1313/21-1-25222~25224	2025.12.23	本次共检电力变压器3台，3台电力变压器所检项目合格。		 2025.12.07	

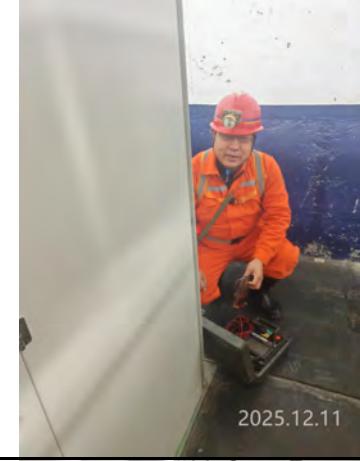
86	GX-B1313/21-1-25225~25227	2025.12.23	本次共检电力变压器3台，3台电力变压器所检项目合格。	 2025.12.09	
87	GX-B1313/21-1-25228~25230	2025.12.23	本次共检电力变压器3台，3台电力变压器所检项目合格。	 2025.12.10	

88	GX-B1313/21-1-25231~25234	2025.12.23	本次共检电力变压器4台，4台电力变压器所检项目合格。	 A photograph showing a worker in a grey uniform sitting on the floor of a control room. He is working with a piece of electronic equipment connected by red and black cables. In the background, there are several large metal cabinets labeled 'KA' and 'KY'. A red stamp in the bottom right corner of the photo reads '2025.12.11'.
89	GX-B1313/21-1-25235~25240	2025.12.23	本次共检电力变压器6台，6台电力变压器所检项目合格。	 A photograph showing a worker in a blue uniform kneeling on the floor in front of a large metal transformer. He is working with a small electronic device. To his left, there is a yellow and black striped barrier tape and a red sign that reads '有电危险 请勿靠近' (High Voltage, Do Not Approach). A red stamp in the bottom right corner of the photo reads '2025.12.11'.

90	GX-B1428/21-1-25357	2025.12.22	无缺陷迹痕显示			
91	GX-B1428/21-1-25358	2025.12.22	无缺陷迹痕显示			

92	GX-B1428/21-1-25359	2025.12.22	无缺陷迹痕显示			
93	GX-B1428/21-1-25360	2025.12.22	无缺陷迹痕显示			

94	GX-B1428/21-1-25361	2025.12.22	无缺陷迹痕显示			
95	GX-B1321/20-1-251125~251129	2025.12.23	本次共检电力电缆5条，5条电力电缆所检项目合格。			

96	GX-B1322/21-1-25327~25330	2025.12.23	本次共检验电力电缆4条，4条所检项目合格。		 2025.12.11	
97	GX-B1322/21-1-25331~25350	2025.12.23	本次共检验电力电缆20条，20条所检项目合格。		 2025.12.12	